



Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Woody Acres/David Wood
Box 12, RR5, Stn Main
Saskatoon SK S7K 3J8 Canada

08/27/08

Test No: 335305


Animal and Sample Description

Animal Name: Fernando 135566283A
Breed: Alpaca(Huacaya)
Sex: Male
Color: Light Fawn

Animal ID: 30011901
Sample Location: Side (R)
Sample Date: 05/12/08
Age: 06/19/05

Laboratory Data

Mean Fiber Diameter: 23.3 microns
Standard Deviation: 4.0 microns
Coefficient of Variation: 17.2 %
Fibers Greater Than 30 microns: 4.3 %

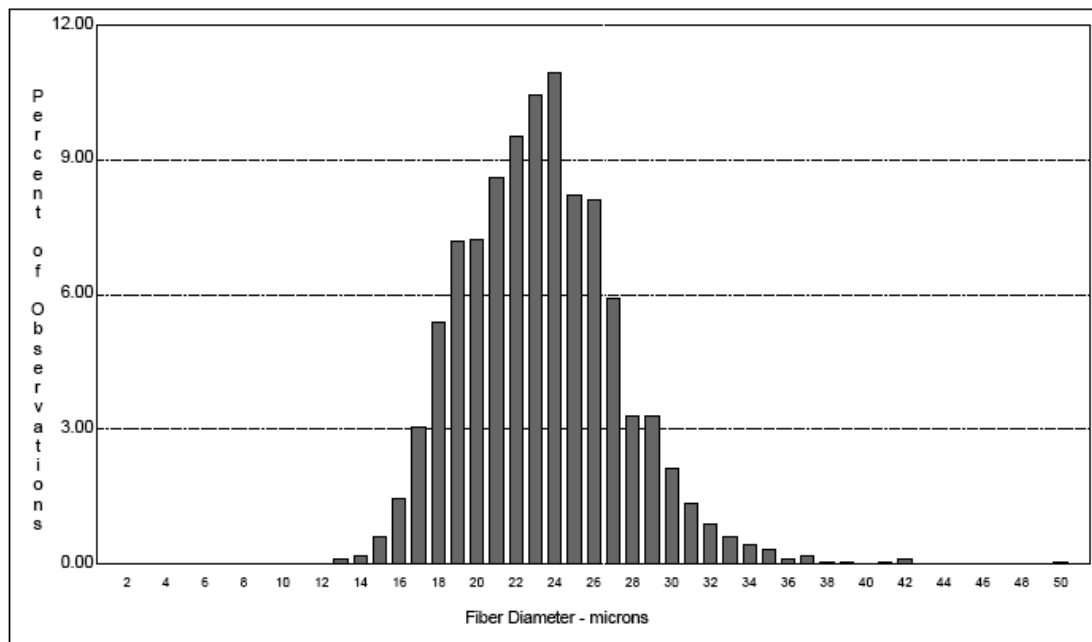

This Test Performed According to I.W.T.O Method 12