



Optical Fiber Diameter Analyser (OFDA100) Micron Test Report

Olde Lyfe
6150 Franktown Rd
Carson City NV, US

Date: 6-Oct-23
Shear ID: 257789
Test No: 615595


Animal and Sample Description

Animal Name: Lovelight's Ray Of Hope
Registry #: 36043668
Breed: Huacaya
Sex: Female
Colour: 205 - Dark Fawn

Date of Birth (Age): 19-Jun-20
Sample Location: GRID
Sample Date: 6-Jul-23
Previous Shear Date: 19-May-22
Total Fleece Wt (lbs): 7.10

Laboratory Data

Mean Fiber Diameter:	22.3 microns	Mean Staple Length:	90 mm
Standard Deviation:	5.8 microns	Length Standard Deviation:	1.7 mm
Coefficient of Variation:	25.9 %	Length Coefficient of Variation:	1.9 %
Spin Fineness:	22.7 microns	Mean Curvature:	53.5 deg/mm
Fibers Greater Than 30 microns:	6.9 %	SD Curvature:	33.8 deg/mm
Comfort Factor:	93.1 %		

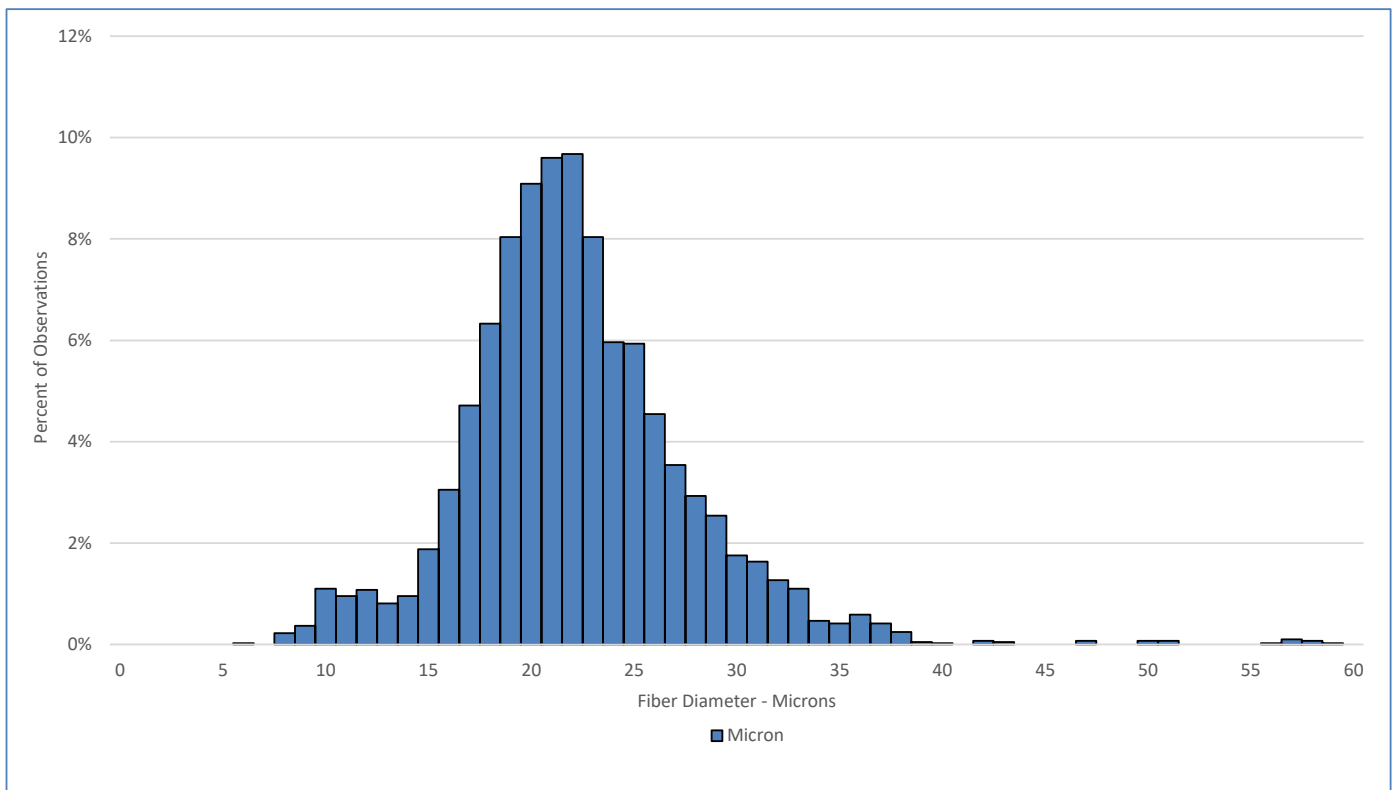

Test Performed According to Method AS/NZS 4492.5:2000

Jeremy Wear
Business Manager

Ioasa Kosena
Authorised Signatory

[SGS General Terms and Conditions](#)

The validity of this document may be confirmed by contacting the address shown below

SGS NZ LTD - 48 Kemp Street, Kilmorie 6022, Wellington, New Zealand. Tel: 64-4-387 8565 Email: WoolOnline@sgs.com Web: www.wooltesting.sgs.com