

Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Pleasant Journey Alpacas/Susan Kacsh
4128 CR 129
Hesperus CO 81326 USA

12/21/12

Test No: 449117


Animal and Sample Description

Animal Name: Never Summer's Manchester
Breed: Alpaca(Huacaya)
Sex: Male
Color: Dark Brown


Animal ID: 31720052
Sample Location: Side
Sample Date: 05/08/12
Age: 09/09/10

Laboratory Data

Mean Fiber Diameter: 19.0 microns
Standard Deviation: 4.0 microns
Coefficient of Variation: 21.1 %
Fibers Greater Than 30 microns: 1.5 %

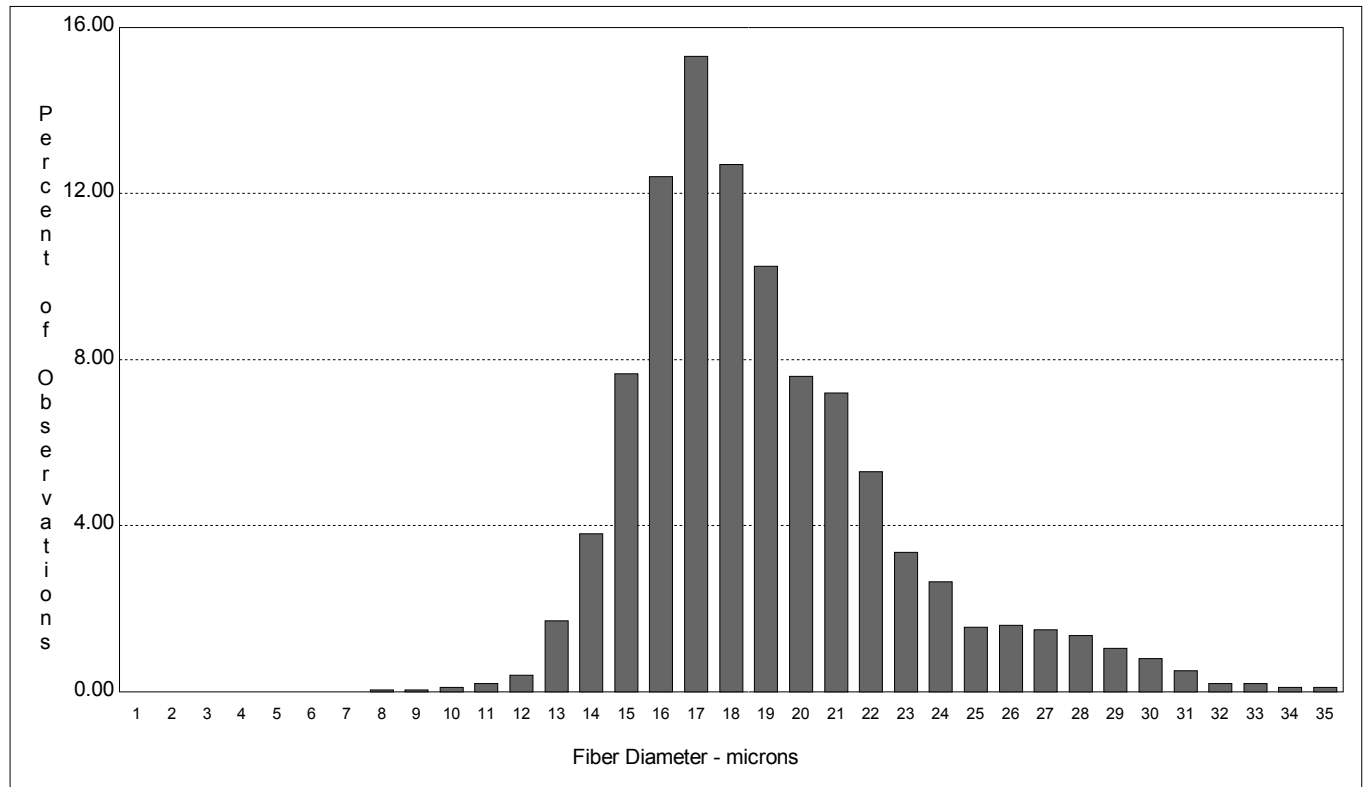

This Test Performed According to I.W.T.O Method 12



Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Pleasant Journey Alpacas/Susan Kacsh
4128 CR 129
Hesperus CO 81326 USA

12/21/12

Test No: 449118


Animal and Sample Description

Animal Name: PJA Tiffany Ice
Breed: Alpaca(Huacaya)
Sex: Female
Color: White/Beige


Animal ID: 31634205
Sample Location: Side
Sample Date: 03/25/12
Age: 01/06/11

Laboratory Data

Mean Fiber Diameter: 19.2 microns
Standard Deviation: 4.5 microns
Coefficient of Variation: 23.3 %
Fibers Greater Than 30 microns: 2.1 %

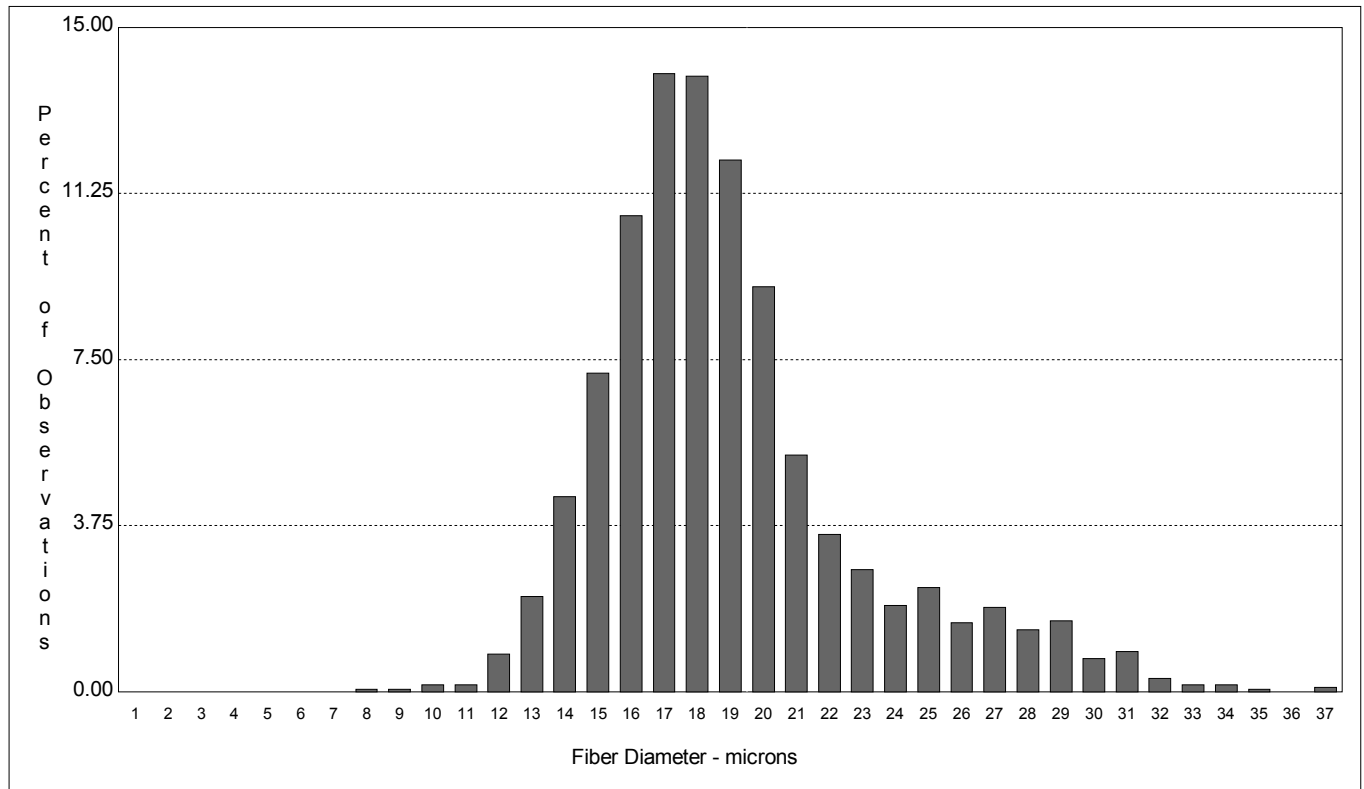

This Test Performed According to I.W.T.O Method 12



Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Pleasant Journey Alpacas/Susan Kacsh
4128 CR 129
Hesperus CO 81326 USA

12/21/12

Test No: 449119


Animal and Sample Description

Animal Name: Adonnis' Altitude NS
Breed: Alpaca(Huacaya)
Sex: Male
Color: Lt Rose Grey

Animal ID: 1096378
Sample Location: Side
Sample Date: 03/25/12
Age: 03/08/08

Laboratory Data

Mean Fiber Diameter: 22.1 microns
Standard Deviation: 6.3 microns
Coefficient of Variation: 28.2 %
Fibers Greater Than 30 microns: 10.8 %

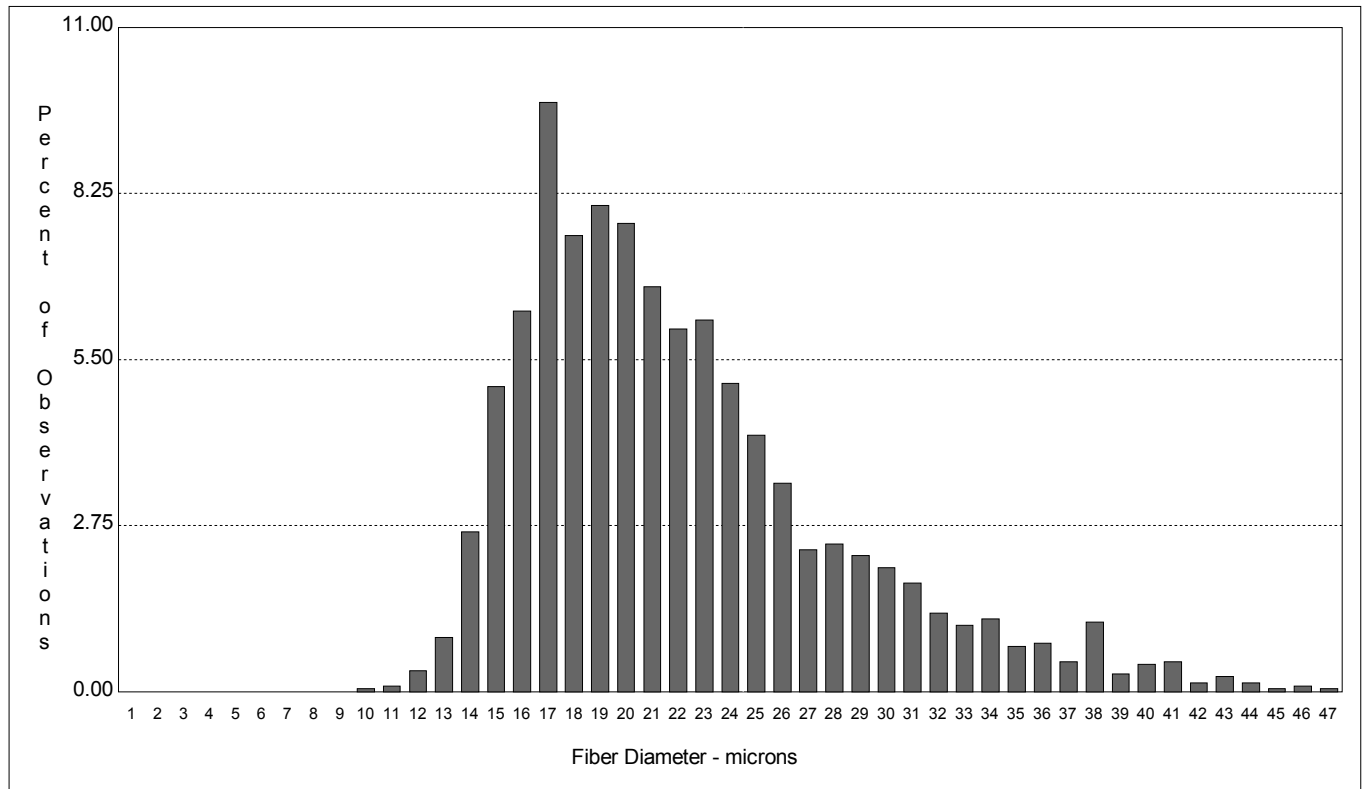

This Test Performed According to I.W.T.O Method 12