



# Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

## Sirolan Laserscan Micron Test Report

Skyline Alpacas/Mary Jaffe  
11100 NW Saltzman Rd  
Portland OR 97229 USA

06/21/17

Test No: 943662


### Animal and Sample Description

**Animal Name:** Daphne  
**Breed:** Alpaca(Huacaya)  
**Sex:** Female  
**Color:** Lt Fawn

**Animal ID:** 35314417  
**Sample Location:** Side  
**Sample Date:** 05/10/17  
**Age:** 09/27/16

### Laboratory Data

**Mean Fiber Diameter:** 18.3 microns  
**Standard Deviation:** 3.4 microns  
**Coefficient of Variation:** 18.3 %  
**Fibers Greater Than 30 microns:** 0.7 %

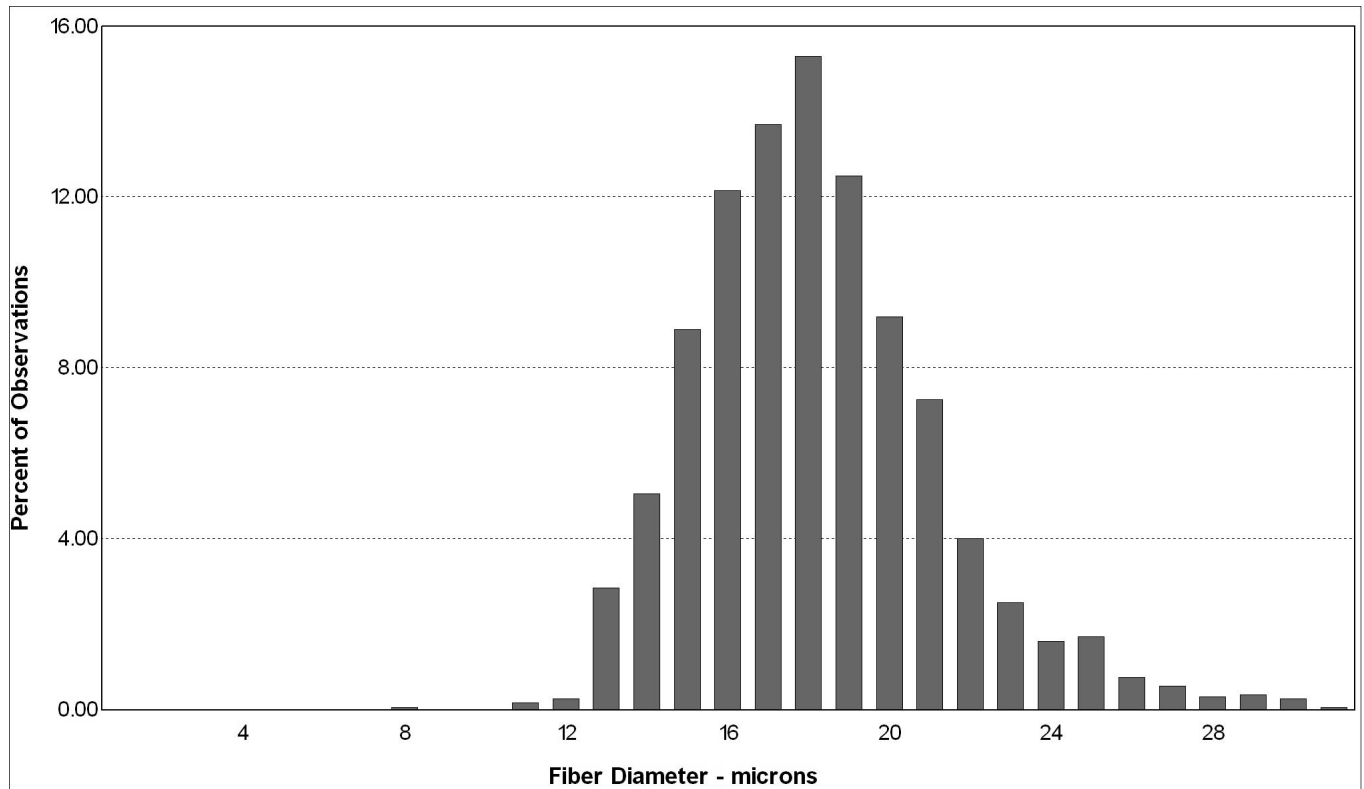

This Test Performed According to I.W.T.O Method 12