



Yocom-McColl Testing Laboratories, Inc.

540 West Elk Place • Denver, Colorado 80216-1823 USA

PHONE (303) 294-0582 • FAX (303) 295-6944

EMAIL: ymccoll@ymccoll.com

Sirolan Laserscan Micron Test Report

Delphi Alpacas/Linda Bat
P.O. Box 9
Coaldale CO 81222

05/29/18

Test No: 960396


Animal and Sample Description

Animal Name: Grey Enough
Breed: Alpaca(Huacaya)
Sex: Male
Color: Lt Silver Grey

Animal ID: XXXXX
Sample Location: Side
Sample Date: 05/17/18
Age: XXXXX

Laboratory Data

Mean Fiber Diameter: 19.3 microns
Standard Deviation: 4.3 microns
Coefficient of Variation: 22.3 %
Fibers Greater Than 30 microns: 1.4 %

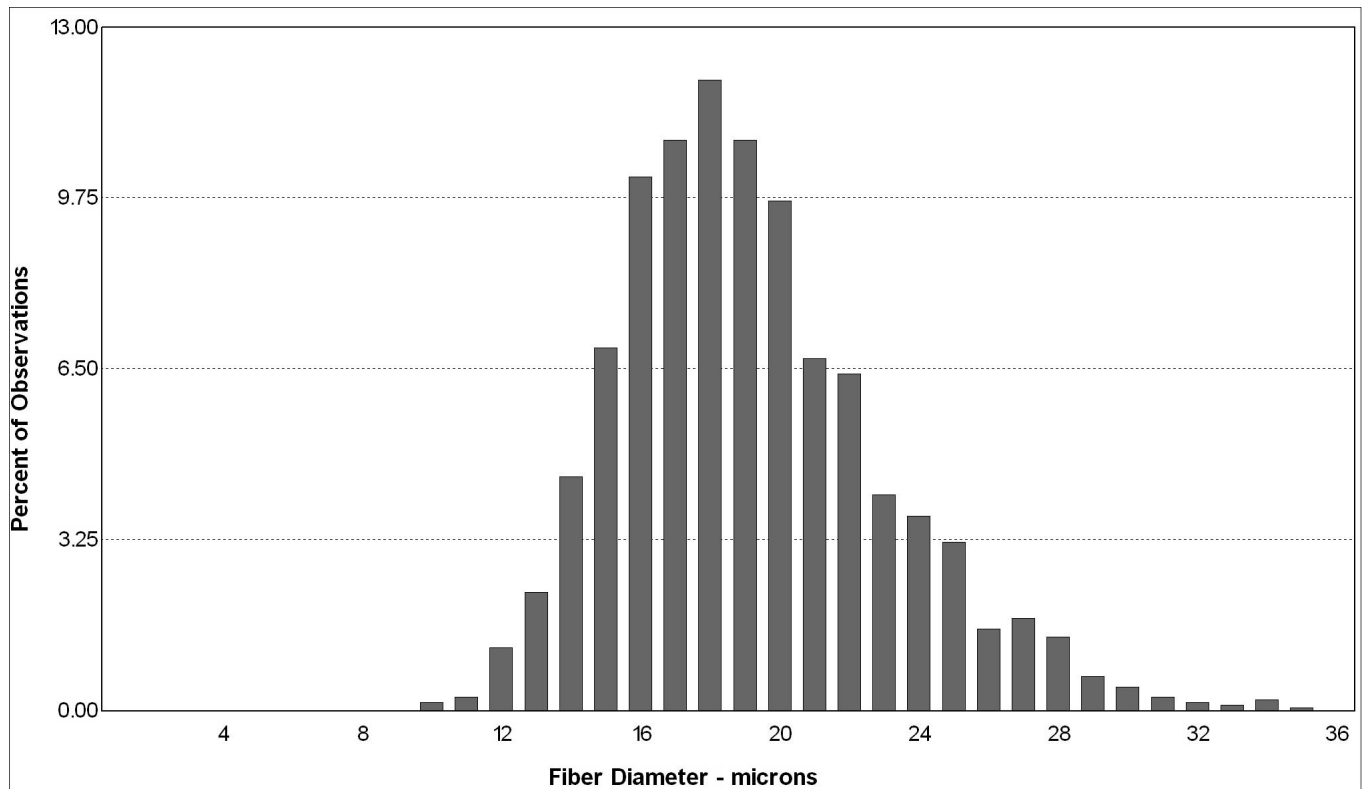

This Test Performed According to I.W.T.O Method 12